


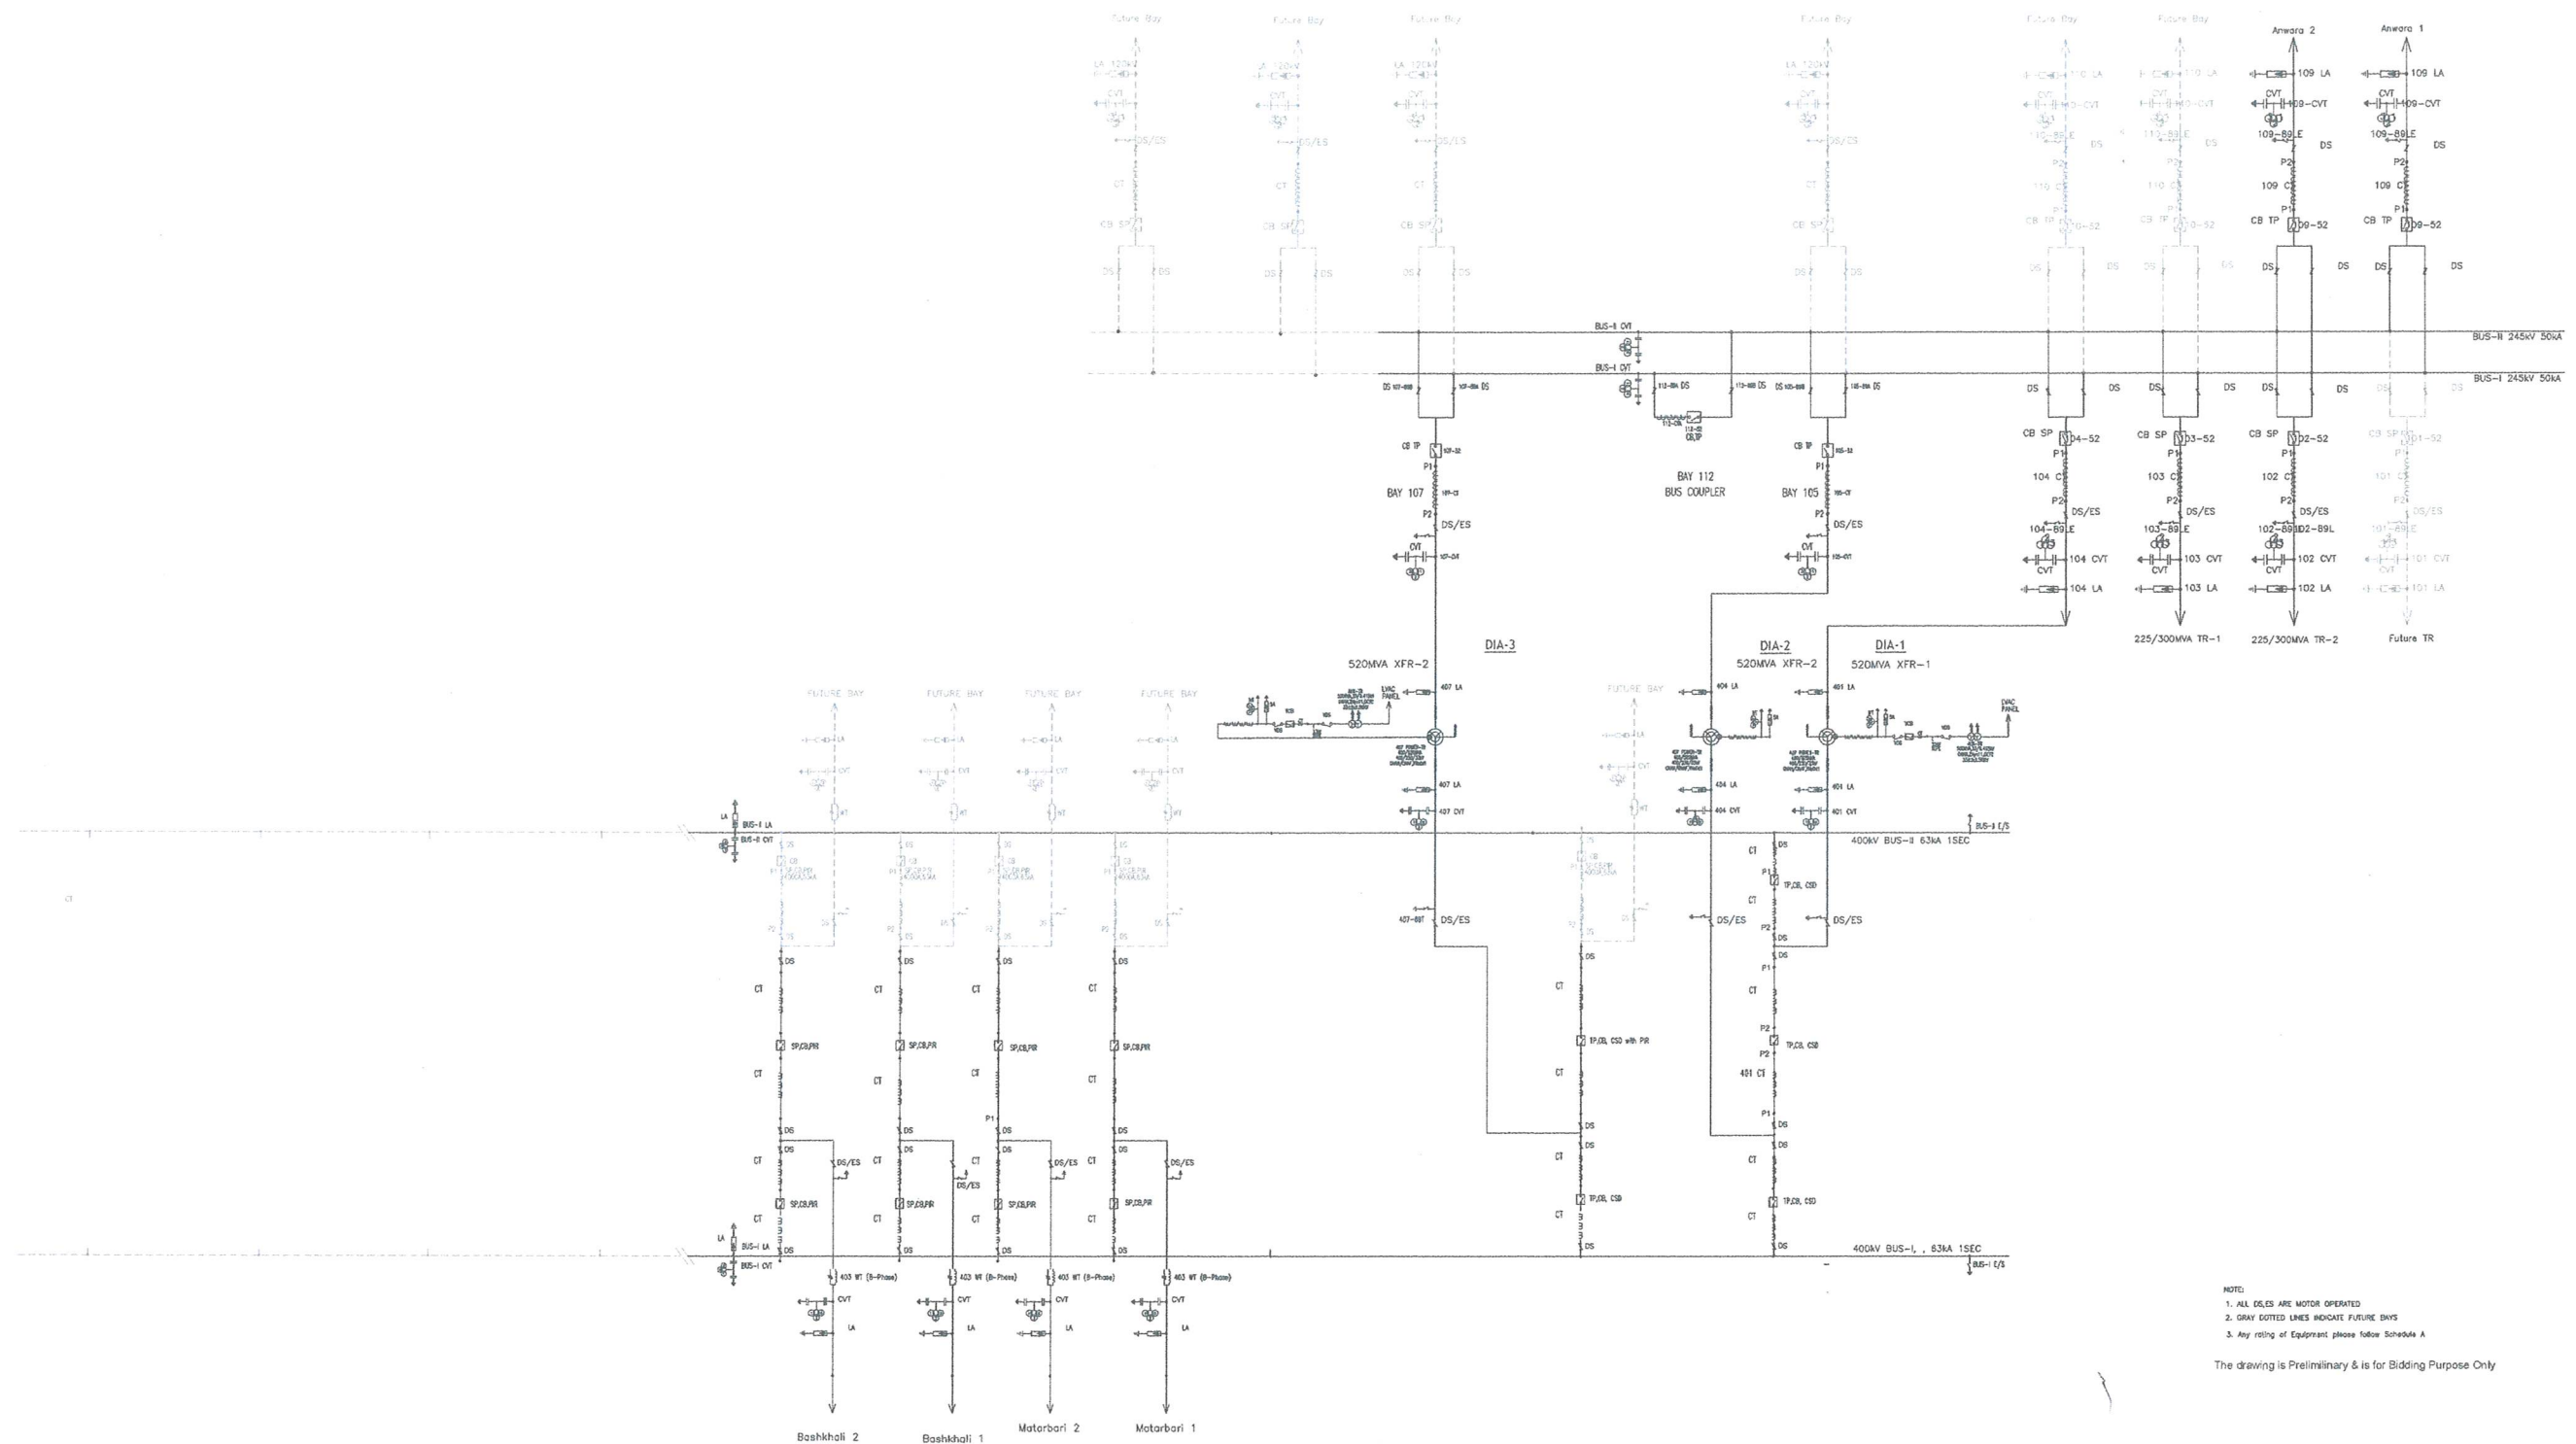

NOTE:

1. ALL DOLLS ARE MOTOR OPERATED
2. GRAY DOTTED LINES INDICATE FUTURE BAYS
3. Any rolling of Equipment please follow Schedule A

The drawing is Preliminary & is for Bidding Purpose Only

Aspirin *Barium* *Sch*

[illegible]

SLD: Revision No.-01

438547

LGED Road

LGED Road

LGED Road

LGED Road

Boundary Wall

Guard House

Main CRB

BUS-1

BUS-2

132kV SPR

Ansar Barrack

Sentry post

This drawing is for TENDER purpose Only

*The drawing is Preliminary & is for Bidding Purpose Only
 *For all technical details, technical requirements, price schedule & volume 3 of the biding documents must be followed.
 *Gantry arrangement & termination height shall be finalized at execution.
 *All the Gentries (column & beam) as shown in the drawing shall be in the scope of this project.



Power Grid Bangladesh PLC

Project

Design, Supply, Installation, Testing & Commissioning of 400/230/132 kV AIS Substation at Pekua and associated single /double circuit 400kV/230kV/132kV LILO Lines on turnkey basis(Package-1)

Drawing Title Overall Layout

Drawing No.

4.PGCB/ADB/LAY_08

Drawn:

Checked:

Approved:

Revision No.-01

Department: Substation Design & Quality Control

309798

252389

105481

72161

264364

Ashim

M. M. M.

Sa